



1 2 3 4 5 6


A

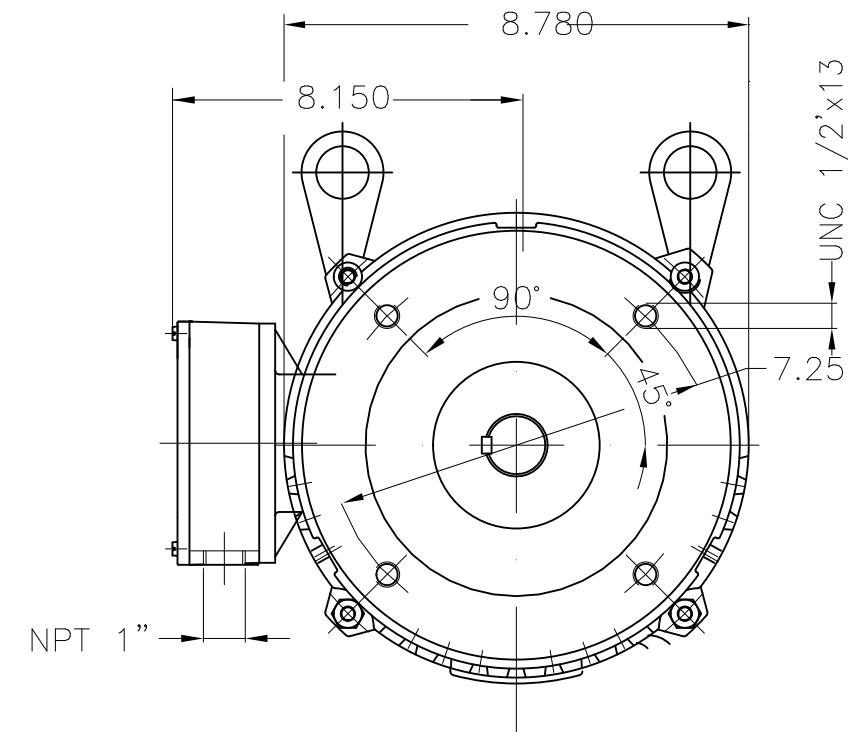

B

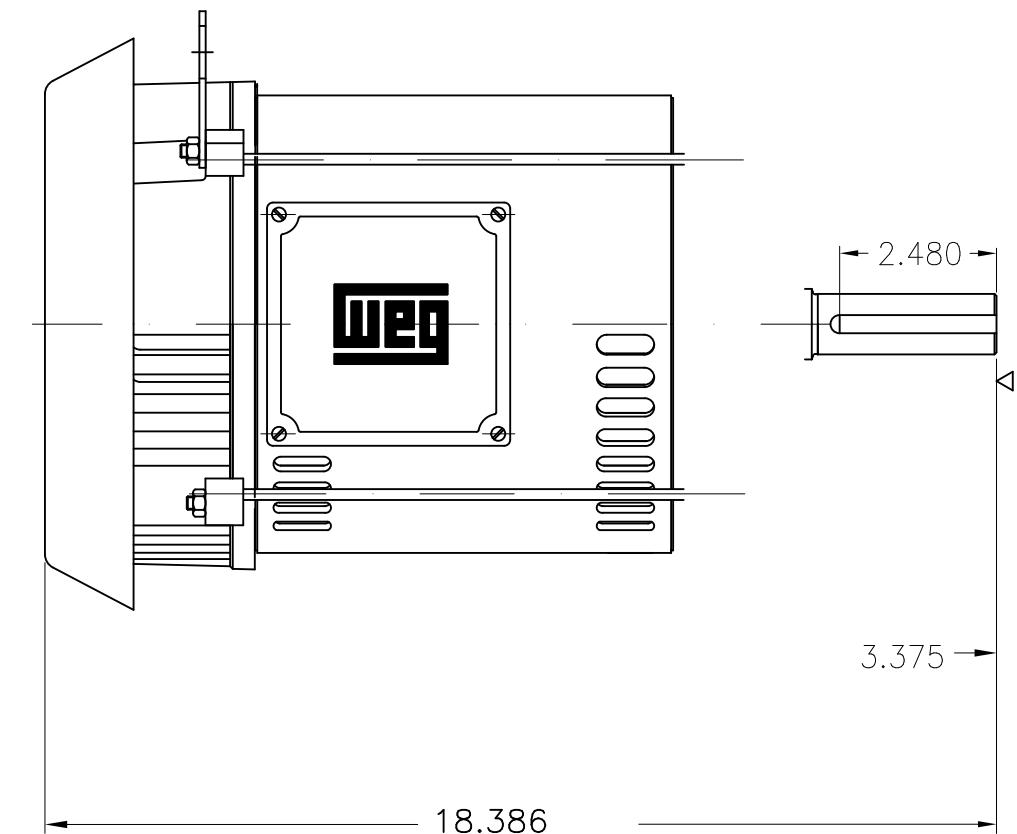

C

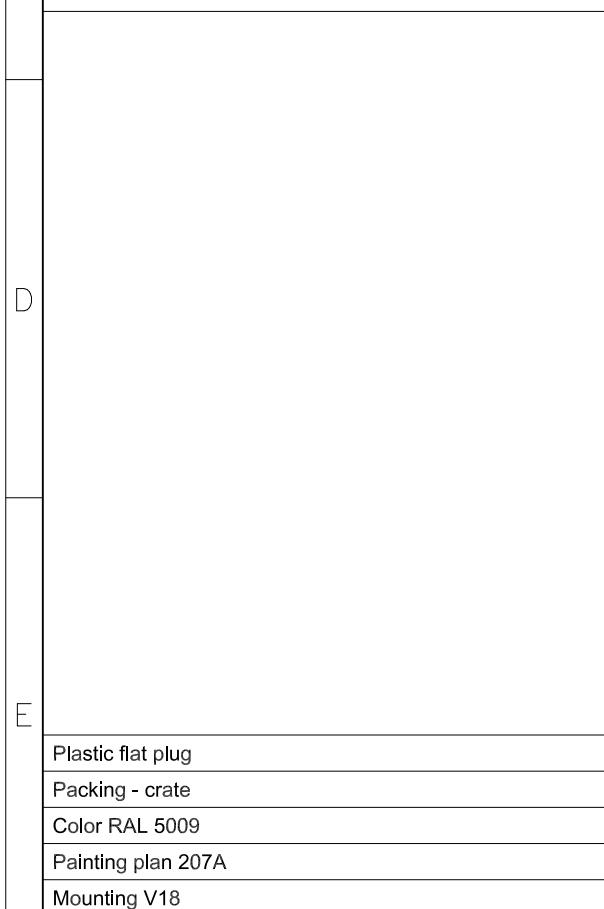

D

E

7.5 HP 04 Poles 60 Hz

EXECUTED	HYBRISUSER	SUMMARY OF MODIFICATIONS			EXECUTED	CHECKED	RELEASED	DATE	VER
CHECKED		THREE PH. MOTOR GENERAL HIGH EFF.							
RELEASED		FRAME 213/5TC IP21 ODP							
REL. DATE		WMO Jaragua do Sul			Product Engineering	SHEET	1 / 1		

Dimensions in inches

A3