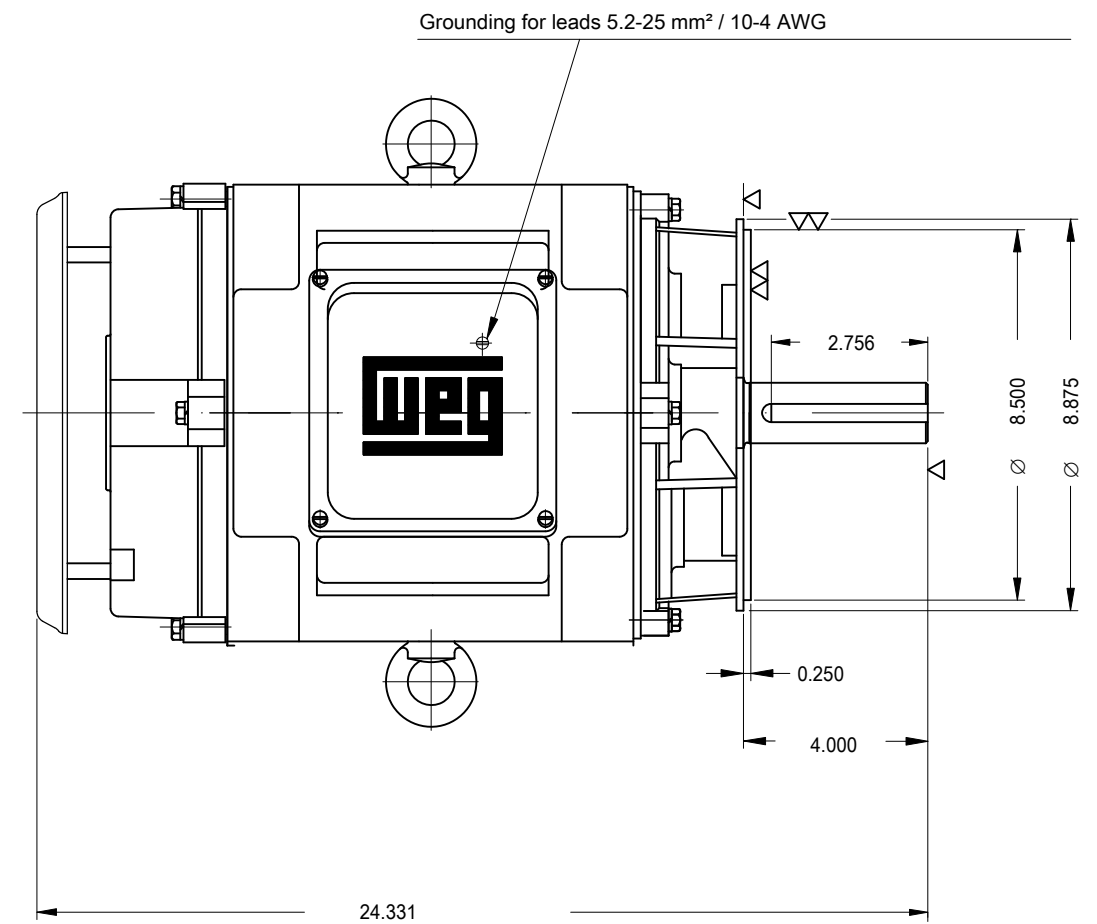
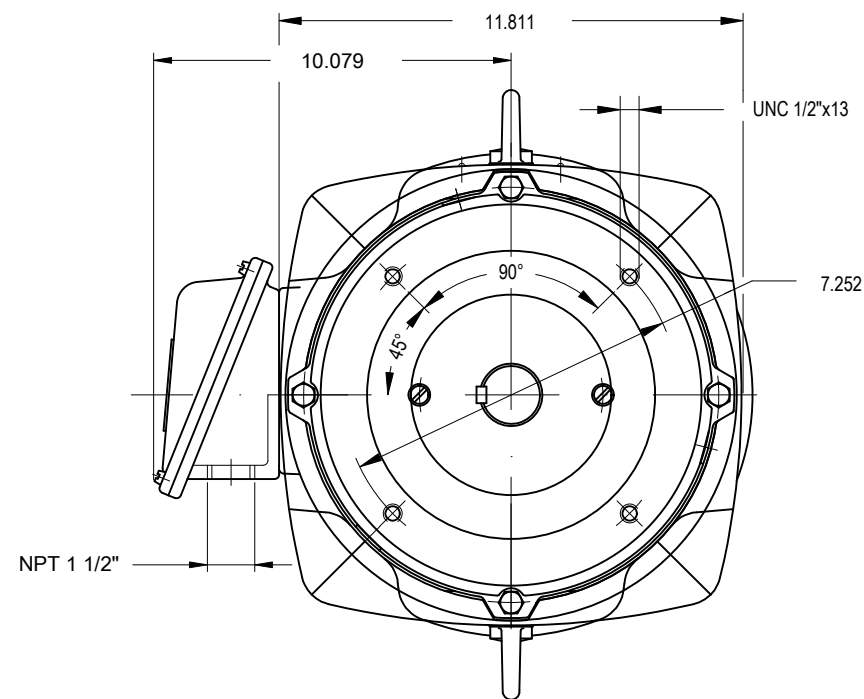



25 HP 02 Poles 60 Hz										A
						HYBRISUSER				00
ECM	LOC	SUMMARY OF MODIFICATIONS				EXECUTED	CHECKED	RELEASED	DATE	VER
EXECUTED	HYBRISUSER		THREE PH. MOTOR GENERAL NEMA PREM. EFF. FRAME 256TC IP23 ODP				PREVIEW WDD 00			
CHECKED										
RELEASED										
REL. DATE		WMO	Jaragua do Sul		Product Engineering		SHEET	1 / 1		